

e Humidity

Air flow

Temperature



Part number


To order, just add the codes to complete the part number.

Measuring range

 1
 -500/+1000 Pa
 For the intermediary and central zero ranges, see

 3
 -250/+500 mbar
 "Configuration".


 4
 Transmitter / power suply / output



Example : CP103-AO

Model : pressure transmitter CP100, measuring range -250/+500 mBar, active sensor, 0-10 V or 4-20 mA output, with display.





Pressure transmitter

TECHNICAL DATASHEET



- Pressure transmitte
- Differential pressure transmitter type CP100
- Measuring ranges from 0/+100 Pa to -1000/+2000 mbar (according to model, see "Configuration")
- Configurable intermediary and central zero ranges
- 0-10 V or 4-20 mA output, active sensor, power supply 24 Vac/Vdc (3-4 wires)
- or 4-20 mA output, passive loop, power supply 18 to 30 Vdc (2 wires)
- ABS IP 65 housing, with or without display
- Quick and easy mounting with the "1/4 turn" system with wall-mount plate

Features of the transmitter

Pressure

Working principle : a piezoresistive sensitive element creates a proportional voltage from the pressure applied on the sensor.

Measuring range	see "Part number"				
Unit of measurement	Pa,mmH ₂ O,mbar,inWG,mmHG (CP101 and CP102)				
	mbar,inWG,mmHG,KPa,PSI (CP 103 and CP 104)				
Accuracy *	±1,5% of reading ±3 Pa (CP 101)				
	$\pm 1,5\%$ of reading $\pm 3 \text{ mmH}_2 O$ (CP102)				
	$\pm 1,5\%$ of reading ± 3 mbar (CP103 and CP104)				
Response time	1/e (63%) 0,3 sec.				
Resolution1Pa-0	,1 mmH ₂ O - 0,01 mbar - 0,01 InHG (CP 101 and CP102)				
0,01mb	ar - 0,01 InWG - 0,01 mmHG - 0,1 KPa - 0,1 PSI (CP 103 and CP104)				
Autozero	manual with push-button				
Type of fluid	air and neutral gases				
Overpressure tolerated					
	1400 mbar (CP 103), 3000 mbar (CP 104).				

Features of the housing

WITH or WITHOUT display


83

Hausian						
Housing	ABS					
Fire-proof classification	HB as per UL94					
Dimensions	see drawing beside					
Protection	IP 65					
Display	5-digit LCD. Dimensions 50 x 15 mm					
Height of the digits	10 mm					
Connections	barbed fittings Ø 5,2mm (CP 101and CP 102)					
	compression fittings Ø 4x6mm (CP 103 and CP 104)					
Cable grip	for cable Ø 7mm max.					
	145g (with display) - 110g (without display)					

Technical Specifications


Output / Power supplya	ctive sensor 0-10V or 4-20mA (power supply 24Vac/Vdc ± 10%), 3-4 wires					
passive loop 4-20 mA (power supply 18/30 Vdc), 2 wires						
n	maximum load : 500 Ohms (4-20 mA)					
n	minimum load : 1 K Ohms (0-10 V)					
Consumption						
Electro-magnetical compatibility EN 61326						
Electrical connection	screw terminal block for cables Ø 1.5 mm ² max					
Communication to PC	Kimo RS 232 cable					
Working temperature	0 to +50°C					
Storage temperature	10 to +70°C					
Environment	air and neutral gases					

*All the accuracies indicated in this technical datasheet were stated in laboratory conditions, and can be guaranted for measurements carried out in the same conditions, or carried out with calibration compensation.

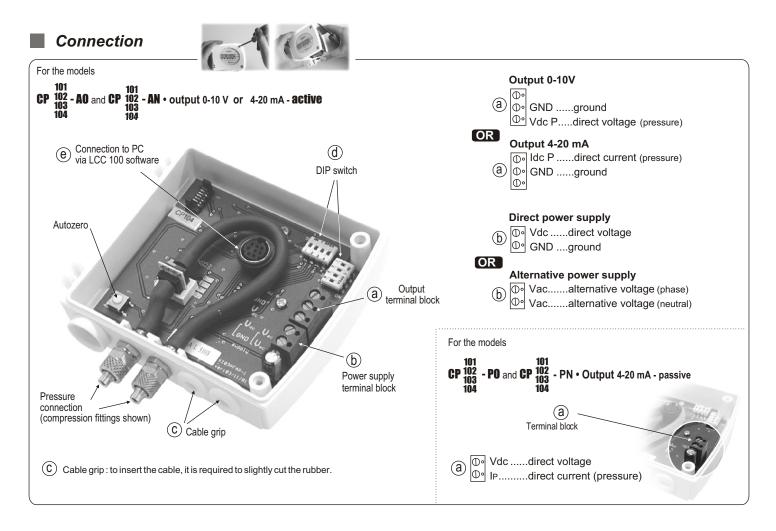

Electrical connections - as per norm NFC15-100

/ This connection must be made by a qualified technician. To make the connection, the transmitter must not be energized.

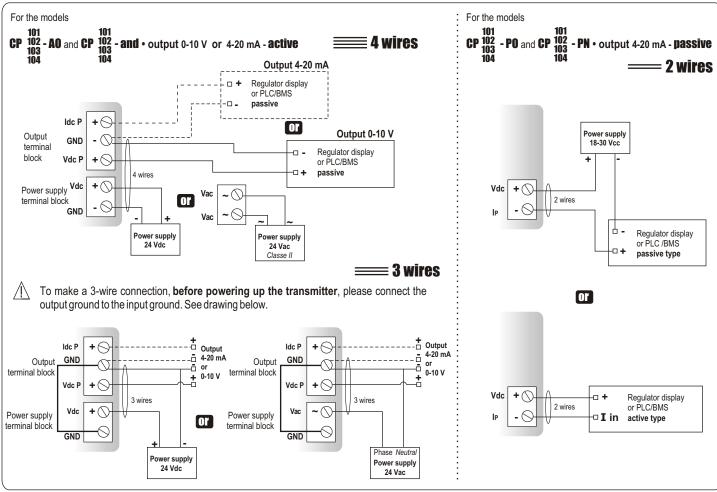

Autozero

Electronic

(d) DIP switch

board

To make an autozero, please disconnect the 2 pressure connections and briefly press on the push-button.

Identification of the DIP switches on the electronic board

Units setting

3 4

2

3

4

102 103

104

DIP switch

2

DIP switch

Configuration

It is possible to configure the measuring ranges, the units, the output of the instrument (according to the model) either by switch and/or via software (connections (e) and (d) on drawing "connection").

Output

On-off switch

Configuration by the DIP switch

To configure the instrument, please unscrew the 2 screws from the housing, and then open it.



To configure the transmitter, it must not be energized. Then, you can make the settings required, with the DIP switches (as shown on the drawing beside). When the transmitter is configured, you can power it up.



Standard range

or central 0 setting

If the combination is wrongly done, the following message will appear on the display of the transmitter "CONF ERROR".

In that case, you will have to unplug the transmitter, place the DIP switches correctly, and then power the transmitter up

• Output setting DIP switch 1

To set the type of analogic output, please put the on-off switch of the output as shown beside.

(For models CP 101 - AO and CP 101 - AN) 102 103 104

. –

2

Configurations	4-20 mA	0-10 V
Combinations	1 2 3 4	

1 F 2 3 4 1000 100,0 10,00 4,00 8,00 1000,0 10000 100,00 40,00 80,00 500 200,0 50,0 10,0 400 2000 800,0 200,0 40,0

Units setting

DIP switch 1 To set the measuring unit, put the

on-off switches 2,3 and 4 of units as shown beside.


Configurations	Ра	mmH2O	mbar	inWG	mmHG	KPa	PSI
Combinations	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4	1 2 3 4
CP101 and CP 102	Х	X	Х	Х	х		
CP103 and CP 104			X	х	X	х	X

• Measuring range setting DIP switch 2 To set the measuring range, put the on-off switches 1, 2 and 3 of the measuring range as	Combi	nations Pa mmH₂O mbar inWG	1 2 3 3 4 100 100 10,0 1,00 0,40	1 2 3 4 250 25,0 2,50 1,00	1 2 3 3 4 500 50,0 5,00 2,00	1 2 3 4 750 75,0 7,50 3,00
shown beside.		mmHG	0,80	2,00	4,00	6,00
	CP 102	mmH ₂ O	100,0	250,0	500,0	750,0
Example : 0> +750 mmH ₂ O, the measuring range is 750 mmH ₂ O -500 Pa> +500 Pa,the measuring range is 1000 Pa		Pa	1000	2500	5000	7500
		mbar	10,00	25,00	50,00	75,00
		inWG	4,00	10,00	20,00	30,00
		mmHG	8,00	20,00	40,00	60,00
To configure other intermediary ranges, and for an easier		mbar	100	200	300	400
and more friendly configuration, please refer to "Configuration via software".		inWG	40,0	80,0	120,0	160,0
Configuration via software .	CP 103	Кра	10,0	20,0	30,0	40,0
		PSI	2,0	4,0	6,0	8,0
		mmHG	80	160	240	320
	CP 104	mbar	500	750	1000	1500
		inWG	200,0	300,0	400,0	600,0
		Кра	50,0	75,0	100,0	150,0
		PSI	10,0	15,0	20,0	30,0
		mmHG	400	600	800	1200

Standard range | central zero setting DIP switch 2

To set the type of range, put the on-off switch 4 as shown beside:

Example : standard / 0 central zero



Configurations Full scale central zero 1 1 2 2 Combinations 3 3

4



1600

4

Initialization of the transmitter

When the transmitter is powered up, it initializes and displays the digits [000000:], and then its configuration including : - the measuring range - the analog output.

1- The measuring range

The following message is displayed : L_{σ} . This is the low value of the measuring range, and its digit value : **ex** : 500. The following message is displayed : H_{I} . This is the high value of the measuring range and its digit value : **ex** : 1000. The arrow displayed (at the bottom or on the right of the screen) is relative to the unit of measurement : ex : from -500 to 1000 Pa.

2 - The analog output

If the analog output is in 4-20mA, then the following message will appear 4-20R If the analog output is 0-10 V, then the following message will appear 0 - 10 U


After the display of the configuration, the transmitter displays - - - - , which confirms that the initialization is finished and you can start the measurements.

Configuration via software (with optional LCC100 software)

An easy and friendly configuration with the software ! You can configure your own intermediary ranges.



Any position (no specific position required)



DIP switch 2



∠ Caution !₋

For a pressure transmitter, the minimum configurable range is 10% of the full range.

Example : for a transmitter with a range of 0-1000 Pa, the minimum configurable range is 0-100 Pa. For example, you can configure your transmitter with a range of -20 to +80 Pa, from 0 to +600 Pa, or from -450 to +450 Pa...

• To access the configuration via software :

- Set the DIP switches as shown beside. Nota : the on-off switch 1 of the DIP switch 1 can be in any position (selection of the analogic output 0-10 V or 4-20 mA).

- Connect the cable to the transmitter plug (see "connections").

• Please refer to the user manual of the LCC 100 to make the configuration.

Caution !

The configuration of the parameters can be done either with the DIP switch or via software (you cannot combine both solutions)

Mounting

Installation : mount the ABS plate on the wall (this plate is supplied with the transmitter). Drilling : Ø 6 mm (with the screws and pins supplied with the transmitter). Insert the transmitter on the plate (see A on the drawing beside) and rotate its housing in clockwise direction until you hear a "click", which confirms that the transmitter is correctly installed.

Caution !-

Once the transmitter is installed and powered up, please make an autozero to guarantee the correct working of the transmitter in any position.



Maintenance

Please avoid any aggressive solvent.

Please protect the transmitter and its probes from any cleaning product containing formol, that may be used for cleaning roots or ducts

Options


- Power supply class 2, input 230 Vac, output 24 Vac. ref.KIAL-100A
- Configuration software LCC 100 supplied with connection RS 232 cable



EXPORT DEPARTMENT

Tel: + 33. 1. 60. 06. 69. 25 - Fax: + 33. 1. 60. 06. 69. 29 site : www.kimo.fr e-mail:export@kimo.fr



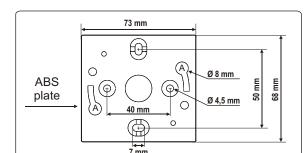



- Through-connections Straight connections -
- Spherical coupling nut -



Distributed by :